



AirVac Vacuum system

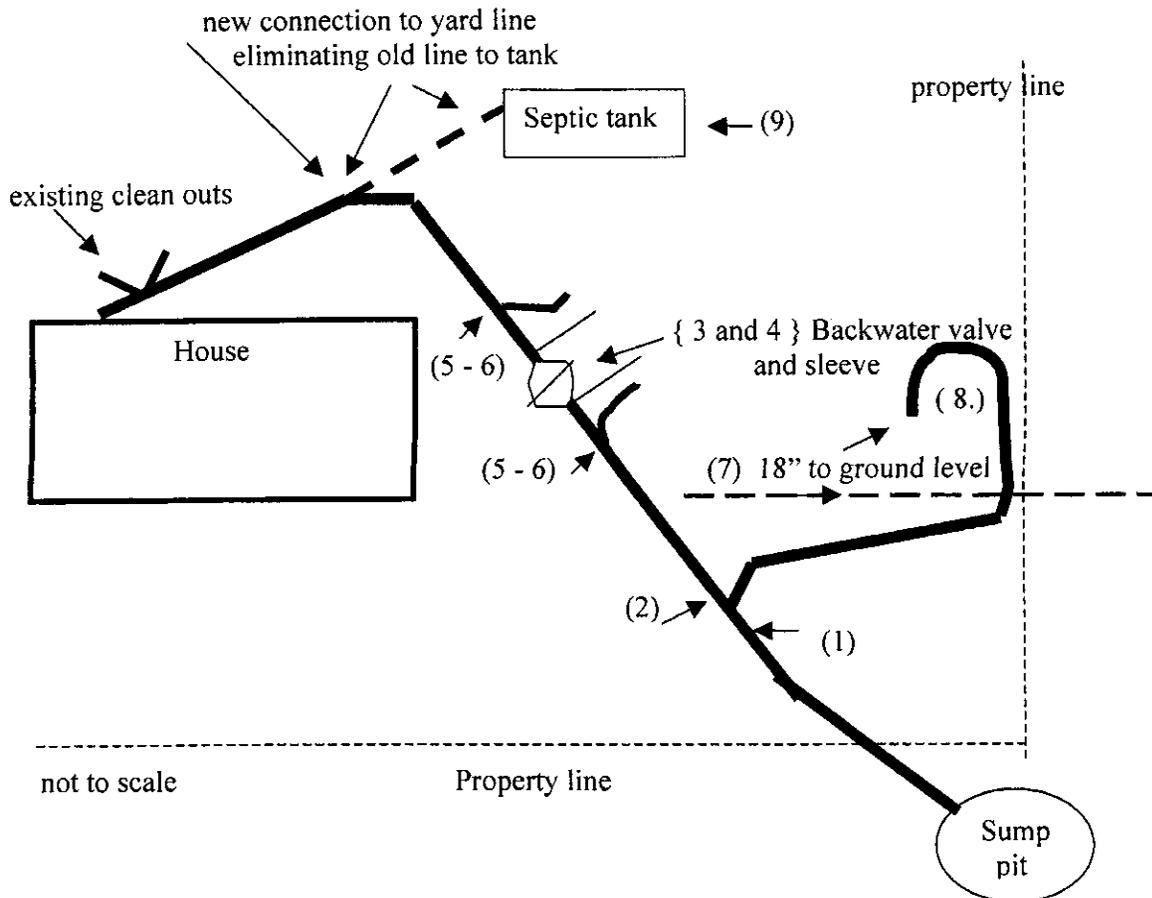

1. Pipe must be a minimum of 4" ABS/PVC Schedule 40 pipe.
2. Vent wye/combo must be at least 20' from sump pit. May be relocated to fence line or behind tree. - maximum 60' from sump pit.
3. A backwater valve must be installed between the vent and the house.
4. The backwater valve must be accessible by means of either a box or a 8" sleeve.
5. Cleanouts can be reversed with backwater valve in the middle.
6. Cleanouts must be installed every 100' of yard line.
7. Candy cane vent must have a clearance of 18" from the ground to the air inlet.
8. Must be 4" minimum from Candy cane to connection at sump pit.
9. Tank must be inspected by EHD within 30 days.

To be used as a guideline. Individual installations will vary.
 Contact Plumbing Dept for any questions. 314- 0350

Dawn 4/19/06
 1-12-12

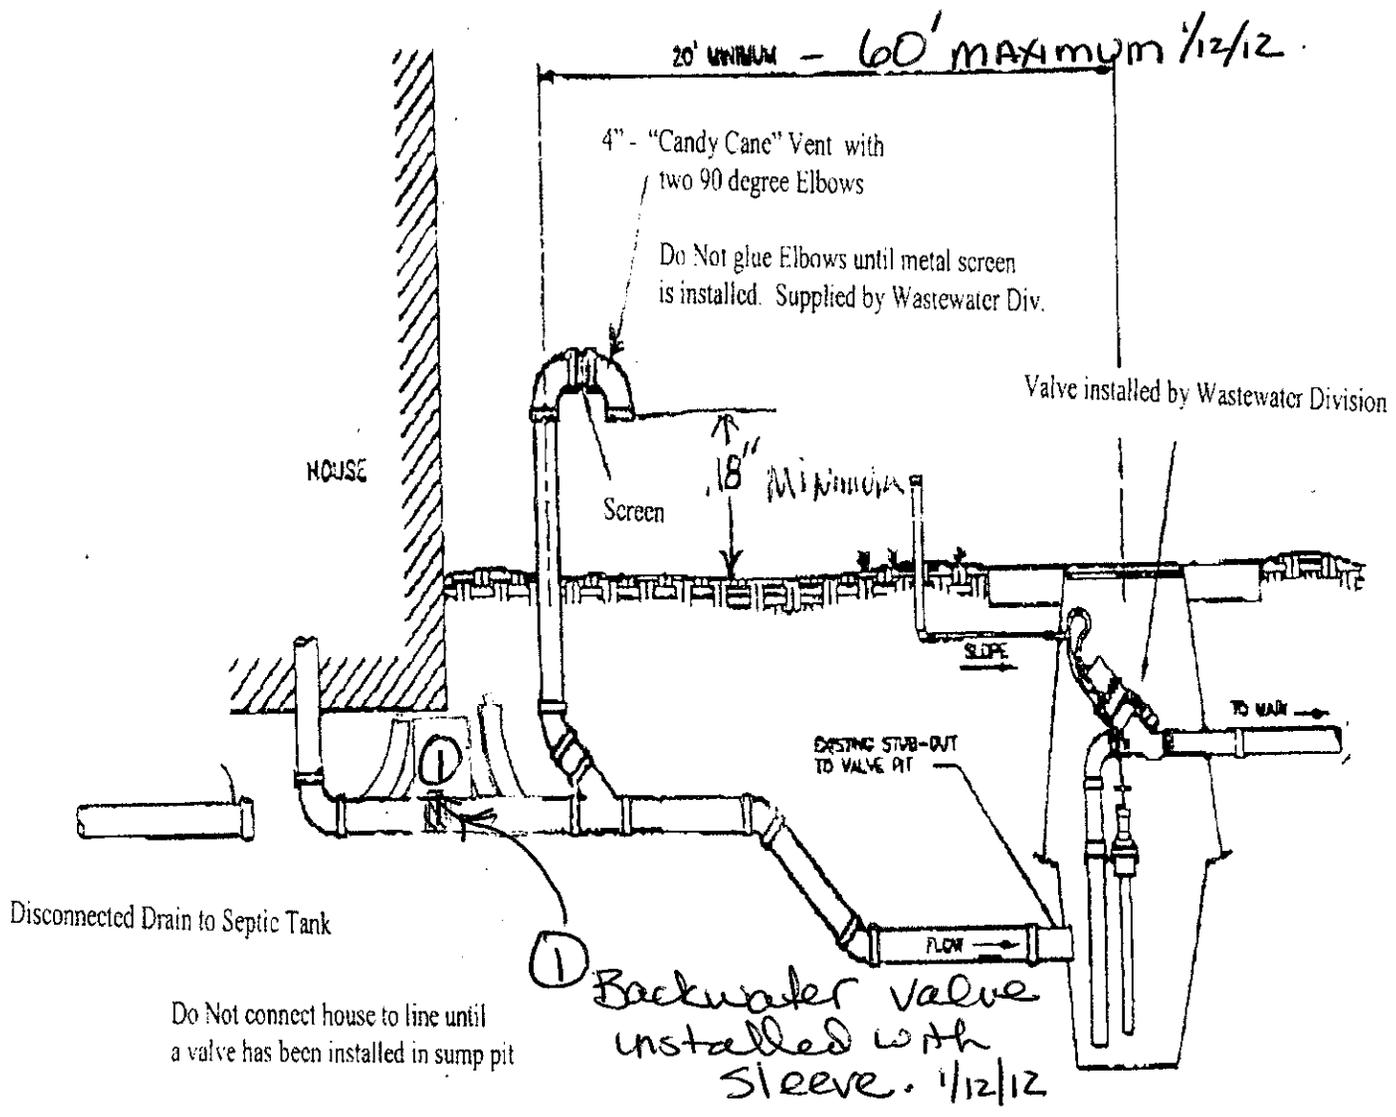

TYPICAL SECTION (COMPLETED INSTALLATION)

To be used as a guideline. Individual installations will vary.
Contact Plumbing Dept for any questions. 314-0350

Down 4/20/06
1/12/12